

WATERBOX GASKETS (CONT'D)

TABLE 43 (CONT'D) - EVAPORATOR WITH STANDARD COMPACT WATERBOXES 150 PSI

SHELL CODE	1 PASS		2 PASS		3 PASS	
	GASKET P/N	FEET REQUIRED	GASKET P/N	FEET REQUIRED	GASKET P/N	FEET REQUIRED
QT-QV	028-03242-000	26'	028-09951-000 028-03242-000	6' 26'	028-09951-000 028-03242-000	8.5' 26'
RQ-RV	028-03242-000	15.9'	028-09951-000 028-03242-000	5.5' 15.9'	028-09951-000 028-03242-000	5.5' 15.9'
R2-R7						
SQ-SV						
S3-S7						
WP-WT						
W1-W6						
XQ-XS	028-03242-000	15.9'	028-09951-000 028-03242-000	5.5' 15.9'	028-09951-000 028-03242-000	5.5' 15.9'
X2-X4						
ZQ-ZS						
Z1-Z4						

NOTE: When ordering Gasket Material specify length required by replacing the -000 with either -025 for 25', -050 for 50', or -100 for 100'.

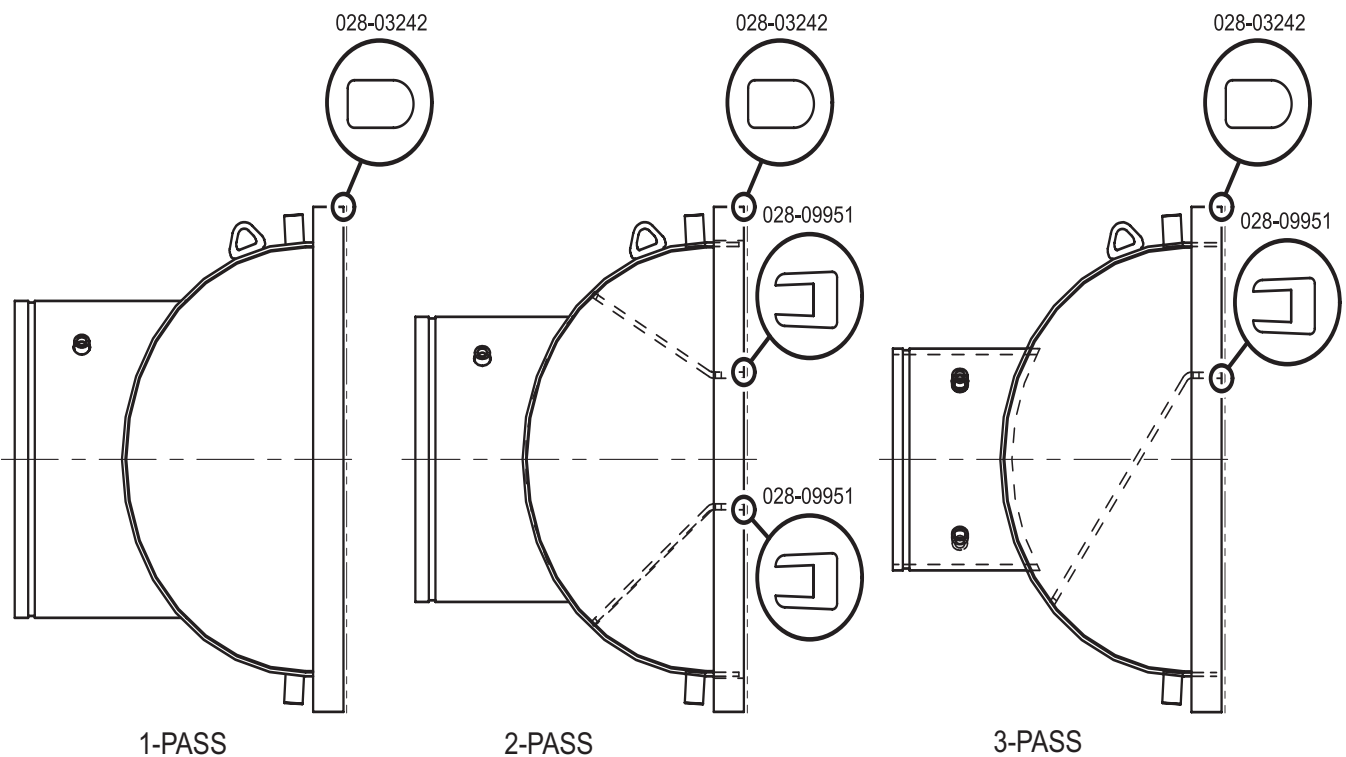


FIGURE 45 - EVAPORATOR 150 LB. WATERBOX GASKET

LD13070